

February 3, 2012

**ADDENDUM NO. 2**

**CITY OF BEAUMONT  
 PROPOSED WASTEWATER TREATMENT IMPROVEMENTS  
 WET WEATHER FLOW IMPROVEMENTS  
 Project Reference Number: WU 0112-01**

**THIS ADDENDUM IS ISSUED FOR THE PURPOSE OF AMENDING THE CONTRACT DOCUMENTS FOR THE CITY OF BEAUMONT, PROPOSED WASTEWATER TREATMENT IMPROVEMENTS, AS FOLLOWS:**

CONTRACT DOCUMENTS


1. Bid Forms: The attached Statement of City Charter, Provision on Conflict of Interest (Pages 1 & 2) is hereby added to the contract documents. The Provision on Conflict of Interest is to be completed by the Contractor and submitted as part of the Bid Package.
2. Scope of Work: Add the following to the Summary of Work:

City will allow for a temporary drainage crossing from the WWTP site directly into the Landfill site along the east WWTP property line. City will coordinate for a temporary pipe crossing at the existing drainage ditch with Drainage District # 6. Tank car(s)- pipe crossings will be provided and backfilled with approximately 1 ft of cover. Contractor will be responsible for any additional fill materials, mats, base material, or other backfill needed for his equipment. Contractor shall be responsible for coordination with Kindermorgan Pipeline Company to cross existing 20" Gasline located along the east property line. Contractor shall be required to protect the existing asphalt plant road by installing dirt cushion and mats. The plant road must also remain passable for chlorine deliveries. Contractor shall be responsible for installing a temporary gate(s) to secure the WWTP site and Landfill site in the existing chainlink fences. All costs for this work shall be subsidiary to Bid Item #2 costs to remove and haul the solids from Pond 1.

SPECIFICATIONS

1. Item 526 – Delete this item in its entirety from the contract documents. Corrugated HDPE pipe material shall not be allowed.
2. Item 508 – High Density Polyethylene Pipe. Add the attached specification for solid wall HDPE pipe. Solid wall HDPE pipe shall be one of the pipe material alternatives for Bid Items #5 and #6.

END OF ADDENDUM NO. 2

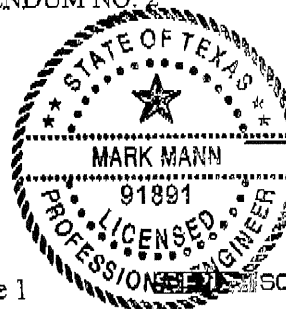

*Mark Mann* 2/3/12  
 Mark Mann, P.E. #91891

### CITY OF BEAUMONT

### STATEMENT OF CITY CHARTER PROVISION ON CONFLICT OF INTEREST

The following provisions were adopted in an effort to avoid potential conflict of interest with prospective bidders and City employees or officers in the awarding of City employees or officers in the awarding of City contracts:

1. No officer, elected or appointed, or other employee of the City shall have a financial interest, direct or indirect, or by reason of ownership of stock or share exceeding one percent (1%) in a business entity contracting with the City. Nor shall such officer or employee be financially interested, directly or indirectly, in the sale to the City of any land, materials, supplies, or services from such business entity, except on behalf of the City in his official capacity as an officer or employee.
2. Any willful violation of this provision shall constitute malfeasance in office and any officer or employee guilty thereof shall thereby forfeit their office or position.
3. Any violation of this section with the knowledge expressed or implied of the person or business entity contracting with the City shall render the contract involved **null and void.** (Beaumont City Charter, Article XVII, Section 9.)

I, \_\_\_\_\_ (name) have read and hereby understand the aforementioned Beaumont City Charter provision prohibiting conflict of interest between City employees or officers and prospective bidders in the award of City contracts. I affirm, to the best of my knowledge and belief, that there is no conflict of interest between the herein stated person or business entity and any City officer or employee if a City contract is awarded. I further state that I have no outside interests that conflict or suggest a potential conflict of interest with the City. I understand that knowledge, express or implied, or concealment of such material fact could nullify and void any such City contract awarded.

If I am awarded this contract, I herein agree to report promptly any further situation that might involve or appear to involve me in any conflict of interest with the City.

SIGNED this the \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_.

\_\_\_\_\_  
Name

\_\_\_\_\_  
Title

<b>CONFLICT OF INTEREST QUESTIONNAIRE</b>		<b>FORM CIQ</b>
<b>For vendor or other person doing business with local governmental entity</b>		
<p>This questionnaire reflects changes made to the law by H.B. 1491, 80th Leg., Regular Session.</p> <p>This questionnaire is being filed in accordance with Chapter 176, Local Government Code by a person who has a business relationship as defined by Section 176.001(1-a) with a local governmental entity and the person meets requirements under Section 176.006(a).</p> <p>By law this questionnaire must be filed with the records administrator of the local governmental entity not later than the 7th business day after the date the person becomes aware of facts that require the statement to be filed. See Section 176.006, Local Government Code.</p> <p>A person commits an offense if the person knowingly violates Section 176.006, Local Government Code. An offense under this section is a Class C misdemeanor.</p>	OFFICE USE ONLY	
	Date Received	
<p><b>1</b> Name of person who has a business relationship with local governmental entity.</p> 		
<p><b>2</b> <input type="checkbox"/> Check this box if you are filing an update to a previously filed questionnaire.</p> <p style="font-size: small;">(The law requires that you file an updated completed questionnaire with the appropriate filing authority not later than the 7th business day after the date the originally filed questionnaire becomes incomplete or inaccurate.)</p>		
<p><b>3</b> Name of local government officer with whom filer has employment or business relationship.</p> <p style="text-align: center;">_____</p> <p style="text-align: center; font-size: small;">Name of Officer</p> <p>This section (Item 3 including subparts A, B, C &amp; D) must be completed for each officer with whom the filer has an employment or other business relationship as defined by Section 176.001(1-a), Local Government Code. Attach additional pages to this Form CIQ as necessary.</p> <p>A. Is the local government officer named in this section receiving or likely to receive taxable income, other than investment income, from the filer of the questionnaire?</p> <p style="text-align: center;"><input type="checkbox"/> Yes      <input type="checkbox"/> No</p> <p>B. Is the filer of the questionnaire receiving or likely to receive taxable income, other than investment income, from or at the direction of the local government officer named in this section AND the taxable income is not received from the local governmental entity?</p> <p style="text-align: center;"><input type="checkbox"/> Yes      <input type="checkbox"/> No</p> <p>C. Is the filer of this questionnaire employed by a corporation or other business entity with respect to which the local government officer serves as an officer or director, or holds an ownership of 10 percent or more?</p> <p style="text-align: center;"><input type="checkbox"/> Yes      <input type="checkbox"/> No</p> <p>D. Describe each employment or business relationship with the local government officer named in this section.</p> 		
<p><b>4</b></p> <p style="text-align: center;">_____</p> <p style="text-align: center; font-size: small;">Signature of person doing business with the governmental entity</p> <p style="text-align: right; margin-right: 100px;">_____</p> <p style="text-align: right; font-size: small;">Date</p>		

Adopted 06/29/2007

## ITEM 508 - HIGH DENSITY POLYETHYLENE PIPE

---

### 508.01 - GENERAL

Furnish High Density Polyethylene pipe and fittings of size(s) shown on plans. This item governs materials, fittings and incidentals required for the joining and bedding of pipe type for use in sanitary sewer.

### 508.02 - MATERIALS

1. Polyethylene pipe shall be of the size and SDR rating as follows:  
63" OD IPS - SDR 32.5 (59.10" ID)  
48" OD IPS - SDR 32.5 (44.93" ID)
2. Polyethylene pipe meeting ASTM F714 and manufactured from a high density, high molecular weight, polyethylene resin which conforms to ASTM D-1248 and meets the requirements for Type III, Class C, Grade P34, Category 5, polyethylene compound and has PPI rating of PE 3408. The pipe produced from this resin shall have a minimum cell classification of PE 4543C per ASTM D3350. Pipe wall color shall be black.

Before beginning work, the Contractor shall submit to the Engineer for approval, the vendor's specific technical data with complete physical properties of pipe and pipe dimensions pertinent to this job.

3. HDPE pipe to be as manufactured by Driscopipe Prisma 4200, or equal.
4. Butt fusion and extrusion welding of HDPE pipe and fittings shall be accomplished with proper equipment and operated in a thoroughly workman manner, in conformance with ASTM D3261. Equipment shall be in good repair. Contractor shall have fusion machine manufacturer's written instructions on site during fusion operations.

Contractor shall employ only skilled welders capable of meeting the qualifications set by the manufacturer's specifications for an acceptable welded joint. Submit samples of fused joints using materials that are intended to be incorporated into the work for Consultant's review and acceptance prior to commencement of pipeline fusing.

A qualified factory designated representative of the HDPE pipe shall be on site when Contractor begins butt fusion of the HDPE pipe, to provide direction and assistance for acceptable fusion of the HDPE, minimum of one day.

7. Fittings to be fitted or fabricated. Fabricated fittings to have SDR rating equivalent to pipe. Fittings to be fusion welded to pipe, except mechanical jointing will be allowed at elbows for the purpose of minimizing stress to the pipe during installation. Mechanical jointing shall include flange adapters fused to the polyethylene pipe and convoluted stainless steel or ductile iron back-up flanges rated for a nominal non-shock operating pressure of 200 psig. Ductile iron flanges to be wrapped in 8 mil polyethylene film to prevent contact with backfill soils. Bolts and nuts to also be of stainless steel.

At constructed dead end of pipe, install back-up flange and flanged reducer and blind flanged end piece. Flanges to be capable of mating with ANSI B16.1 fitting standard with a minimum working pressure of 150 psi.

## ITEM 508 - HIGH DENSITY POLYETHYLENE PIPE

---

### 508.03 - INSTALLATION

1. Trenching - To be in accordance with Item "Underground Piping Construction". Excavate trench to a point 4 inches below the bottom of pipe.
2. Pipe Zone Bedding - Install in accordance with ASTM D-2321. Install Class IA rock bedding and backfill material from 4" below the pipe to 6" above the pipe. Hand tamp bedding material around haunches to a point six (6) inches above the top of pipe.
3. Backfill Above Pipe Zone - To be in accordance with Item "Underground Piping Construction".

### 508.05 - MEASUREMENT AND PAYMENT

Measurement and payment to be made in accordance with "Underground Piping Construction".